

# TEST REPORT

Sample name  
&Model

Rechargeable Li-ion Battery  
ELESHELL5K

Applicant

Fujian Bettenergy technology Co.Ltd

Manufacturer

Liwatt Contemporary Amperex Technology  
Co., Ltd.

深圳诚测检测技术有限公司  
Shenzhen CCJC Technology Co., Ltd



**TEST REPORT**  
**IEC 62619**

Secondary cells and batteries containing alkaline or other non-acid electrolytes -  
Safety requirements for secondary lithium cells and batteries, for use in industrial  
applications

**Report Number.....:** CCJC20241624401

Date of issue .....: 2024-10-18

Total number of pages .....: 17 pages

**Applicant's name .....** Fujian Bettenergy technology Co.LtdAddress .....: Unit 5,Unit 1203,No.359 Chengyi Street,Phase III of Xiamen  
Software Park,Fujian Province,China**Manufacturer's name .....** Liwatt Contemporary Amperex Technology Co., Ltd.Address .....: Floor 2, Building 3, No.33 Gongye South Road, Chengnan  
Industrial Park, Chengnan Town, Ninghua County, Sanming City,  
Fujian Province**Factory's name .....** Liwatt Contemporary Amperex Technology Co., Ltd.Address .....: Floor 2, Building 3, No.33 Gongye South Road, Chengnan  
Industrial Park, Chengnan Town, Ninghua County, Sanming City,  
Fujian Province**Test specification:**

Standard .....: IEC 62619: 2022

Test procedure .....: Test Report

Non-standard test method .....: N/A



Test item description .....: Rechargeable Li-ion Battery

Trade Mark.....:



Model/Type reference .....: ELESHELL5K

Ratings.....: 51.2V, 100Ah, 5120Wh

<b>Testing procedure and testing location:</b>	
<b>Testing Laboratory:</b> Testing location/ address.....: Shenzhen CCJC Technology Co.,Ltd. 1-3/F.,Building 101, No.135-3, Shasong Road, Houting, Shajing Street, Bao'an District, Shenzhen,Guangdong, China	
Tested by (name + signature).....: Qin Heng Ning	 .....
Approved by (name + signature).....: Roc Cheng	 .....
<b>List of Attachments:</b> Appendix 1: 3 pages of Photo Documentation	
<b>Summary of testing:</b>	
<b>Tests performed (name of test and test clause):</b> cl.7.2.1 External short-circuit test (cell or cell block); cl.7.2.2 Impact test (cell or cell block); cl.7.2.3 Drop test (cell or cell block, and battery system); cl.7.2.4 Thermal abuse test (cell or cell block); cl.7.2.6 Forced discharge test (cell or cell block); cl.7.3.2 Internal short-circuit test (cell); cl.8.2.2 Overcharge control of voltage (battery system); cl.8.2.3 Overcharge control of current (battery system); cl.8.2.4 Overheating control (battery system)  The samples comply with the requirement of IEC 62619: 2022.	<b>Testing location:</b> Shenzhen CCJC Technology Co.,Ltd. 1-3/F.,Building 101, No.135-3, Shasong Road, Houting, Shajing Street, Bao'an District, Shenzhen,Guangdong, China
<b>Summary of compliance with National Differences</b> N/A	

**Copy of marking plate**

The artwork below may be only a draft. The use of certification marks on a product must be authorized by the respective NCBs that own these marks.

Rechargeable Li-ion Battery

ELESHELL-5K

IFpP51/161/117[16S]M/-20+65/95

51.2V 100Ah 5120Wh

Liwatt Contemporary Amperex Technology Co.,Ltd.

YYMMDD    Made in china



<b>Test item particulars</b> .....:
<b>Classification of installation and use</b> .....: To be defined in final product
<b>Supply Connection</b> .....: DC supply
.....: --
<b>Possible test case verdicts:</b> - test case does not apply to the test object.....: N/A - test object does meet the requirement .....: P (Pass) - test object does not meet the requirement .....: F (Fail)
<b>Testing</b> .....:
<b>Date of receipt of test item</b> .....: 2024-09-29
<b>Date (s) of performance of tests</b> .....: 2024-09-29 to 2024-10-18
<b>General remarks:</b> The test results presented in this report relate only to the object tested. This report shall not be reproduced, except in full, without the written approval of the Issuing testing laboratory. "(See Enclosure #)" refers to additional information appended to the report. "(See appended table)" refers to a table appended to the report. Throughout this report a point is used as the decimal separator.

**General product information:**

This battery system is constructed with 16 Li-ion cells (16S1P), and has overcharge, over-discharge, over current and short-circuits proof circuit.

The main features of the battery system are shown as below:

Product name	Rechargeable Li-ion cell	Rechargeable Li-ion Battery
Model	LF100LA	ELESHELL5K
Rated capacity	100Ah	100Ah
Nominal voltage	3.2V	51.2V
Nominal Charge Current	20A	60A
Maximum Charge Current	100A	100A
Nominal Discharge Current	20A	60A
Maximum Discharge Current	100A	100A
Maximum Charge Voltage	3.65V	57.6V
Cut-off Voltage	2.5V	46.4V
Upper charge temperature	65°C	55°C
Lower charge temperature	0°C	0°C
Upper discharge temperature	65°C	55°C
Lower discharge temperature	-20°C	0°C
Storage temperature range	-20°C to 65°C	0°C to 55°C
Recommend charging method declared by the manufacturer	Charging the cell with 20A constant current until 3.65V, then constant voltage untill the charge current reduces to 5A at ambient 25°C±5°C.	Charging the battery with 60A constant current until 57.6V, then constant voltage untill the charge current reduces to 5A at ambient 25°C±5°C.
Charging procedure for internal short-circuit test	Charging the cell with 100A constant current until 3.65V, then constant voltage untill the charge current reduces to 5A at ambient 25°C±5°C.	--
Recommend discharging method declared by the manufacturer	Discharged at 25±5 °C at a constant current 20A down to 2.5V.	Discharged at 25±5 °C at a constant current 60A down to 46.4V
Nominal mass (kg):	2.0	47.95
External dimensions (mm):	50.6*160.8*116.2	610*370*163

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict
<b>4</b>	<b>PARAMETER MEASUREMENT TOLERANCES</b>		<b>P</b>
	Parameter measurement tolerances		P
<b>5</b>	<b>GENERAL SAFETY CONSIDERATIONS</b>		<b>P</b>
<b>5.1</b>	<b>General</b>		<b>P</b>
	Cells and batteries are safe under conditions of both intended use and reasonably foreseeable misuse..... :		P
<b>5.2</b>	<b>Insulation and wiring</b>		<b>P</b>
	Voltage, current, altitude, and humidity requirements		P
	Adequate clearances and creepage distances between connectors		P
	The mechanical integrity of internal connections		P
<b>5.3</b>	<b>Venting</b>		<b>P</b>
	Pressure relief function	Venting mechanism exists on top of the prismatic cell.	P
	Encapsulation used to support cells within an outer casing	No such construction.	N/A
<b>5.4</b>	<b>Temperature/voltage/current management</b>		<b>P</b>
	The design prevents abnormal temperature-rise		P
	Voltage, current, and temperature limits of the cells		P
	Specifications and charging instructions for equipment manufacturers		P
<b>5.5</b>	<b>Terminal contacts of the battery pack and/or battery system</b>		<b>P</b>
	Polarity marking(s)		P
	Capability to carry the maximum anticipated current		P
	External terminal contact surfaces		P
	Terminal contacts are arranged to minimize the risk of short circuits		P
<b>5.6</b>	<b>Assembly of cells, modules, or battery packs into battery systems</b>		<b>P</b>
<b>5.6.1</b>	<b>General</b>		<b>P</b>
	Independent control and protection method(s)		P
	Recommendations of cell operating limits by the cell manufacturer		P
	Batteries designed for the selective discharge of a portion of their series connected cells		P

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict
	Protective circuit component(s) and consideration to the end-device application		P
5.6.2	Battery system design		P
	The voltage control function		P
	The voltage control for series-connected batteries		P
<b>5.7</b>	<b>Operating region of lithium cells and battery systems for safe use</b>		<b>P</b>
	The cell operating region..... :	Specify in cell user manual.	N/A
	Designation of battery system to comply with the cell operating region		P
<b>5.8</b>	<b>Quality plan</b>		<b>P</b>
	Manufacturing quality plan (for example: ISO9001, etc.) prepared and implemented..... :	Complied. ISO 9001: 2015 certificate provided.	P
	The process capabilities and the process controls		P
<b>6</b>	<b>TYPE TEST CONDITIONS</b>		<b>P</b>
<b>6.1</b>	<b>General</b>		<b>P</b>
<b>6.2</b>	<b>Test items</b>		<b>P</b>
	Cells or batteries that are not more than six months old (See Table 1 of IEC62619)		P
	Capacity confirmation of the cells or batteries		P
	Default ambient temperature of test, 25 °C ± 5 °C		P
<b>7</b>	<b>SPECIFIC REQUIREMENTS AND TESTS</b>		<b>P</b>
<b>7.1</b>	<b>Charging procedure for test purposes</b>		<b>P</b>
	The battery discharged to a specified final voltage prior to charging		P
	The cells or batteries charged using the method specified by the manufacturer.....:		P
<b>7.2</b>	<b>Reasonably foreseeable misuse</b>		<b>P</b>
7.2.1	External short-circuit test (cell or cell block)		P
	Short circuit with total resistance of 30 mΩ ± 10 mΩ at 25 °C ± 5 °C		P
	Results: no fire, no explosion	See Table 7.2.1.	P
7.2.2	Impact test (cell or cell block)		P
	Cylindrical cell, longitudinal axis impact	Prismatic cell	P
	Prismatic cell, longitudinal axis and lateral axis impact		N/A



IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict
	Results: no fire, no explosion.	No fire, no explosion.	P
7.2.3	Drop test (cell or cell block, and battery system)		P
7.2.3.1	General		P
7.2.3.2	Whole drop test (cell or cell block, and battery system)		P
	Description of the Test Unit .....	Cell	—
	Mass of the test unit (kg) .....	Approx. 2.0kg	—
	Height of drop (m) .....	1.0m	—
	Results: no fire, no explosion		
7.2.3.3	Edge and corner drop test (cell or cell block, and battery system)		
	Description of the Test Unit .....	Battery	—
	Mass of the test unit (kg) .....	Approx. 47.95kg	—
	Height of drop (cm).....	10cm	—
	Results: no fire, no explosion		
7.2.4	Thermal abuse test (cell or cell block)		P
	Results: no fire, no explosion		P
7.2.5	Overcharge test (cell or cell block)		P
	For those battery systems that are provided with only a single protection for the charging voltage control		—
	Results: no fire, no explosion.....	See Table 7.2.5.	P
7.2.6	Forced discharge test (cell or cell block)		P
	Upper limit charge voltage of the cell .....	3.65V	P
	Cells connected in series in the battery system..		N/A
	Redundant or single protection for discharge voltage control provided in battery system .....		N/A
	Target Voltage.....	-3.65V applied.	P
	Maximum discharge current of the cell, $I_m$ .....	100A	P
	Discharge current for forced discharge, $1.0 I_t$ .....	100A	P
	Discharging time, $t = (1 I_t / I_m) \times 90$ (min.) .....	90min	P
	Results: no fire, no explosion.....	See Table 7.2.6.	P
<b>7.3</b>	<b>Considerations for internal short-circuit – Design evaluation</b>		<b>P</b>
7.3.1	General		P
7.3.2	Internal short-circuit test (cell)		P

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict
	Samples preparation procedure: a), in accordance with 8.3.9 of IEC62133:2012; or b), the nickel particle inserted before charging, or c), the nickel particle was inserted before electrolyte filling .....	a)	P
	Tested according to Cl. 8.3.9 of IEC 62133:2012 test method, except all tests were carried out in an ambient temperature of 25 °C ± 5 °C.		P
	The appearance of the short-circuit location recorded by photograph or other means .....		—
	The pressing was stopped - When a voltage drop of 50 mV was detected; or		N/A
	- The pressing force of 800 N (cylindrical cells) or 400 N (prismatic cells) was reached	400N	P
	Results: no fire, no explosion.....	See Table 7.3.2.	P
<b>7.3.3</b>	<b>Propagation test (battery system)</b>	7.3.2 was selected.	<b>N/A</b>
	Method to create a thermal runaway in one cell :		N/A
	Results: No external fire from the battery system or no battery case rupture .....		N/A
<b>8</b>	<b>BATTERY SYSTEM SAFETY (CONSIDERING FUNCTIONAL SAFETY)</b>		<b>P</b>
<b>8.1</b>	<b>General requirements</b>		<b>P</b>
	Functional safety analysis for critical controls		P
	Conduct of a process hazard, risk assessment and mitigation of the battery system		P
<b>8.2</b>	<b>Battery management system (or battery management unit)</b>		<b>P</b>
8.2.1	Requirements for the BMS		P
	The safety integrity level (SIL) target of the BMS		P
	The charge control evaluated by tests in clauses 8.2.2 to 8.2.4		P
8.2.2	Overcharge control of voltage (battery system)		P
	The exceeded charging voltage applied to the whole battery system		P
	The exceeded charging voltage applied to only a part of the battery system, such as the cell(s) .....		P
	Results: no fire, no explosion.....	See Table 8.2.2.	P
	The BMS interrupted the overcharging before reaching 110% of the upper limit charging voltage		P
8.2.3	Overcharge control of current (battery system)		P

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict
	Results: no fire, no explosion.....:	See Table 8.2.3	P
	The BMS detected the overcharging current and controlled the charging to a level below the maximum charging current		P
8.2.4	Overheating control (battery system)		P
	The cooling system, if provided, was disconnected		P
	Elevated temperature for charging, 5 °C above maximum operating temperature.....:		P
	Results: no fire, no explosion..... :	See Table 8.2.4	P
	The BMS detected the overheat temperature and terminated charging		N/A
	The battery system operated as designed during test		P
<b>9</b>	<b>INFORMATION FOR SAFETY</b>		<b>P</b>
	The cell manufacturer provides information about current, voltage and temperature limits of their products		P
	The battery system manufacturer provides information regarding how to mitigate hazards to equipment manufacturers or end-users.	Specific in battery system user manual.	P
<b>10</b>	<b>MARKING AND DESIGNATION (REFER TO CLAUSE 5 OF IEC 62620)</b>		<b>P</b>
	The marking items shown in Table 1 in IEC 62620 indicated on the cell, battery system or instruction manual.		P
	Cell or battery system has clear and durable markings		P
	Cell designation		N/A
	Battery designation	IFpP51/161/117[16S]M/-20+65/95	P
	Battery structure formulation		P
<b>ANNEX A</b>	<b>OPERATING REGION OF CELLS FOR SAFE USE</b>		<b>P</b>
A.1	General		P
A.2	Charging conditions for safe use		P
A.3	Consideration on charging voltage		P
A.4	Consideration on temperature		P
A.5	High temperature range		P

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict

A.6	Low temperature range		P
A.7	Discharging conditions for safe use		P
A.8	Example of operating region		P

ANNEX B	PROCEDURE OF 7.3.3 PROPAGATION TEST		N/A
B.1	General		N/A
B.2	Test conditions:		N/A
	– The battery fully charged according to the manufacturer recommended conditions..... :		—
	– Target cell forced into thermal runaway..... :		—
	– A specially prepared sample (e.g. a heater or a hole for nail penetration provided) used for ease of testing ..... :		—
B.3	Method used for initiating the thermal runaway. 1) Heater (Heater, Burner, Laser, Inductive heating 2) Overcharge 3) Nail penetration of the cell 4) Combination of above methods 5) Other methods ..... :		—

ANNEX C	PACKAGING		P
	The materials and pack design chosen in such a way as to prevent the development of unintentional electrical conduction, corrosion of the terminals and ingress of environmental contaminants		P

7.2.6	TABLE: Forced discharge test (cell or cell block)					P
Sample No.	OCV before applying reverse charge, (V dc)	Target Voltage (V dc)	Measured Reverse Charge Current It, (A)	Total Time for Reversed Charge Application (min)	Results	
C06#	2.82	-3.65	100	90	A	
<b>Supplementary information:</b> Results: A - No fire or Explosion B - Fire C - Explosion D - Other (Please explain): ____						

7.3.2	TABLE: Internal short-circuit test (cell)				P
Sample No.	OCV at start of test, (V dc)	Particle location <sup>1)</sup>	Maximum applied pressure, (N)	Results	
C07#	3.45	1	400	A,E	
C08#	3.46	1	400	A,E	
C09#	3.34	1	400	A,E	
C10#	3.45	1	400	A,E	
C11#	3.45	1	400	A,E	

**Supplementary information:**

<sup>1)</sup> Identify one of the following:

1: Nickel particle inserted between positive and negative (active material) coated area.

2: Nickel particle inserted between positive aluminium foil and negative active material coated area.

**Results:**

A - No fire or explosion

B – Fire

C - Explosion

D – Test concluded when 50 mV voltage drop occurred prior to reaching force limit

E – Test concluded when 800/400N pressure was reached and 50 mV voltage drop was not achieved

F – Test was concluded when fire or explosion occurred

G - Other (Please explain): \_\_\_\_

7.3.3	TABLE: Propagation test (battery system)				N/A
Sample No.	OCV of Battery System Before Test, (V dc)	OCV of Target Cell Before Test, (V dc)	Maximum Cell Case Temperature, (°C)	Maximum DUT Enclosure Temperature, (°C)	Results
Method of cell failure <sup>1)</sup>		Location of target cell		Area for fire protection (m <sup>2</sup> )	

E - Other (Please explain): \_\_\_\_\_

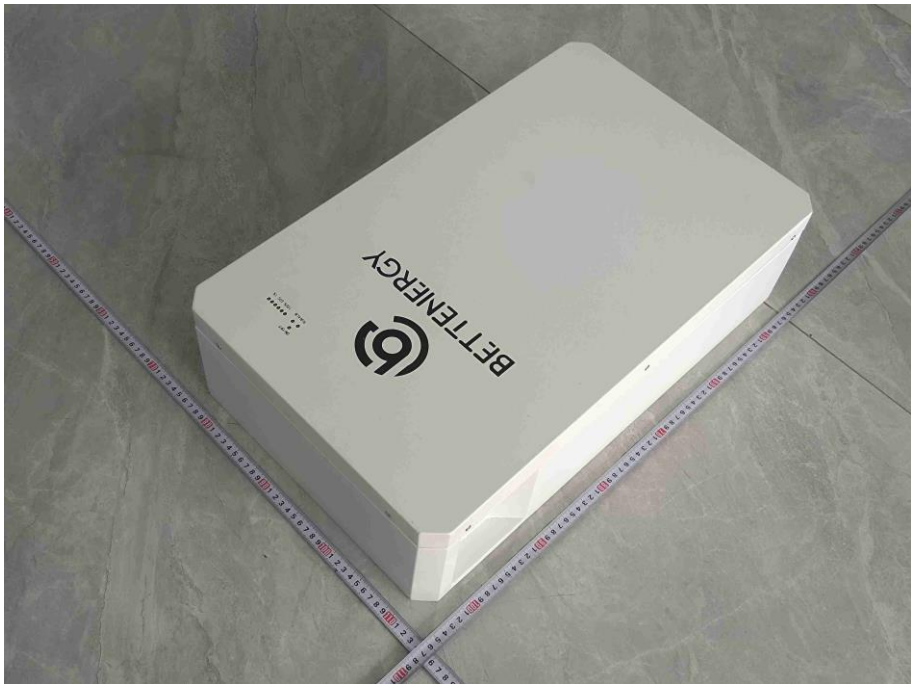
H - Other (Please explain): \_\_\_\_\_


8.2.3	TABLE: Overcharge control of current (battery system)				P
Sample No.	OCV at start of test, (V dc)	Max. Charging Current, (A)	Max. Charging Voltage, (V dc)	Results	
B02#	45.10	12	57.6	A,D,F	
<b>Supplementary information:</b> Results: A – No fire or Explosion B – Fire C – Explosion D - Overcurrent sensing function of BMU did operate and then charging stopped E - Overcurrent sensing function of BMU did not operate and then charging stopped F - All function of battery system did operate as intended during the test. G - All function of battery system did not operate as intended during the test. H - Other (Please explain): _____					

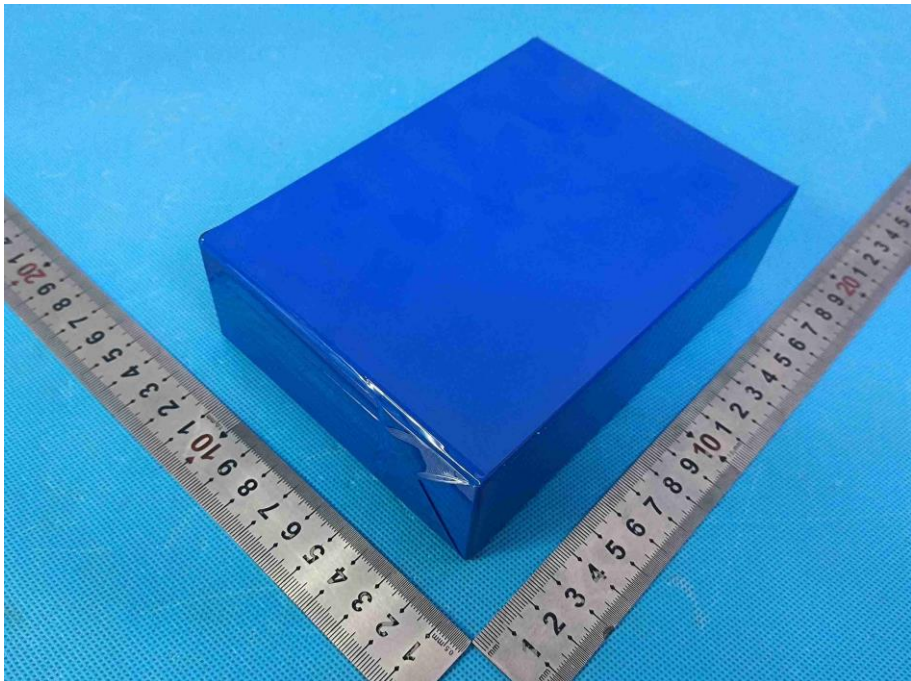
8.2.4	TABLE: Overheating control (battery system)			P
Model No.	OCV at start(SOC 50%) of test, V dc	Maximum Charging Current, A	Maximum Charging Voltage, V dc	
B03#	52.67	100	57.6	
Maximum Specified Temperature of Battery System, °C		Maximum Measured Cell Case Temperature, °C	Results	
55		58.7	A,D,F	
<b>Supplementary information:</b> Results: A – No fire or Explosion B – Fire C – Explosion D - Temperature sensing function of BMU did operate and then charging stopped E - Temperature sensing function of BMU did not operate and then charging stopped F - All function of battery system did operate as intended during the test. G - All function of battery system did not operate as intended during the test. H - Other (Please explain): _____				

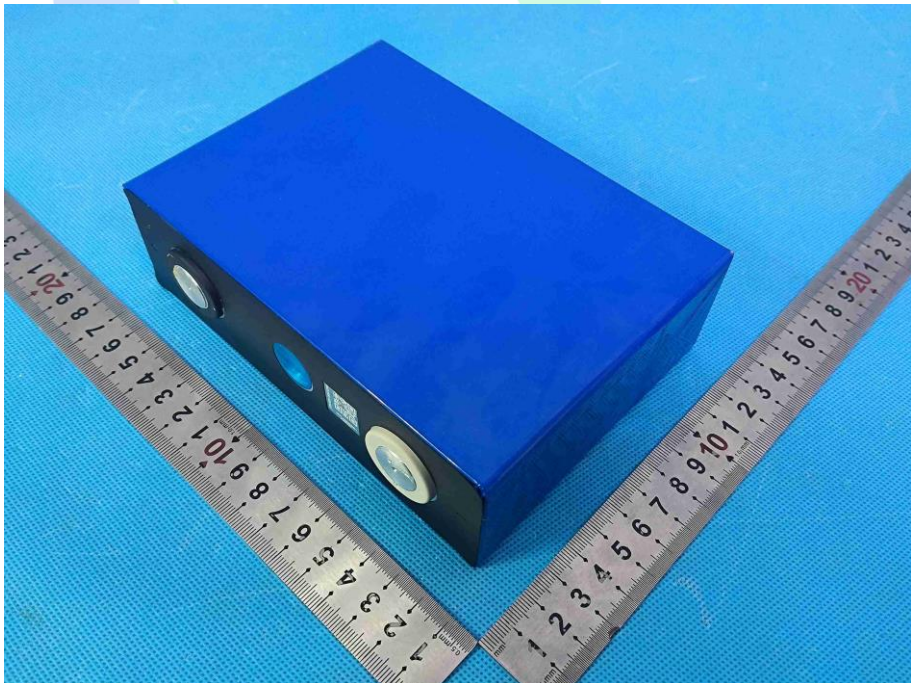


**Appendix 1**
**Photo Documentation**

Details of:	Fig.1– Front view of battery system
	

Details of:	Fig. 2 Back view of battery system
	

Details of:	Fig. 3 Back view of cell
	

Details of:	Fig. 4 Back view of cell
	

---End of Test Report---